



WIRING DIAGRAM FOR FREE LEADS

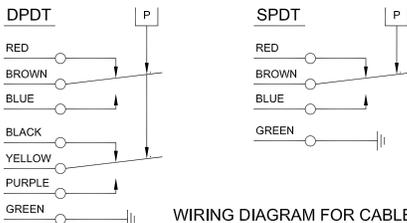

WIRING DIAGRAM FOR CABLE

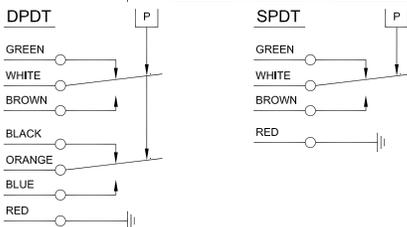

NAMEPLATE ELECTRICAL RATING

11 AMP RATING	11 AMPS 1/4 HP 125, 250 VAC 5 AMPS 30 VDC; 0.5 A 125 VDC
5 AMP RATING	5 AMPS 125, 250 VAC; 5 AMPS 30 VDC
1 AMP RATING	1 AMP 125 VAC; 1 AMP 30 VDC GOLD CONTACTS

FOR SERVICE OR ORDERING INFORMATION

Consult factory or authorized factory representative. Specify full catalog part number (with optional modification) and factory set-point.

WARRANTY

All CCS products and services are sold subject to: "CCS standard terms and conditions of sale".

The CCS UL/CSA, ATEX-SIRA, IECEx certified switches are designed to provide long life and maintain excellent setpoint accuracy under adverse environmental conditions.

Check nameplate on the switch for maximum proof (overpressure) limits. If you have any questions, please contact CCS sales department or CCS authorized sales representatives.

CCS Custom Control Sensors, Inc. 21111 Plummer St. Chatsworth, Ca.	Et. Rating
	Wiring Diagram
Sira 08ATEX1046X II 2 GD Ex d IIC Ex ID A21 IECEx SIR 10,0193X	S/N
CE 1180 IP66 & IP67	
T6 (Tamb. -40° C/+71° C) & T5 (Tamb. -40° C/+86° C)	
WARNING: AFTER DE-ENERGIZING, DELAY 10 MINUTES BEFORE OPENING	

GENERAL:

- Observe all Warnings and Cautions contained on the attached Warning Sticker, the Warning Declaration and the CCS catalog.
- Follow all applicable governmental or other codes or regulations.
- Special conditions for safe use: The integral free lead wires or cable shall be mechanically protected and terminated in a suitable junction or terminal facility.
- If the field wiring is terminated in an explosive atmosphere, then a suitability certified termination facility shall be used.

MOUNTING:

- Units may be directly mounted in any position at the source of the variable pressure sensed.

WARNING: RELEASE ALL PRESSURE PRIOR TO INSTALLATION OR REMOVAL OF THIS DEVICE.

- Units are supplied with male NPT ports suitable for connection to NPT taper threaded pipe with max. installation torque of 12 ft. lb.
- Pipe joint sealing compound is preferred over Teflon tape. However, either method of sealing is acceptable with proper care to avoid introducing sealing material into pressure switch or plumbing.

ELECTRICAL CONNECTIONS:

WARNING: DO NOT MAKE ELECTRICAL CONNECTIONS WHILE ELECTRICAL POWER IS ON. THIS PRODUCT MUST BE INSTALLED BY A QUALIFIED ELECTRICIAN TO AVOID RISK OF ELECTROCUTION.

- Electrical conductors are provided within a male conduit connection. Flexible conduit is recommended.
- When making wire connections disconnect electrical power. Check for multiple circuits.
- Make electrical connections in accordance with the appropriate codes and regulations. Keep as much wire as possible for a service loop to facilitate service, see wiring diagrams.
- Proper grounding must be accomplished by use of ground wire as provided. It is the responsibility of the user to ensure proper and effective arrangements are made for earth fault protection and equi-potential bonding functions or some other equally effective method.
- The Terminal Box Kit option is available, see selection guide on CCS website.

ADJUSTMENT:

Pressure settings are externally adjustable. (Not applicable if units are factory set)

- If the electrical circuit cannot be used for testing, disconnect electrical power and use a suitable circuit tester or light box.
- Disconnect pipe nipples or NPT taper threaded pipe from the pressure port. Insert 1/8" Allen wrench into adjustment screw (located inside pressure port) and turn clockwise to decrease setting, then attach to a variable pressure source with a suitable gage and check that the circuit continuity operates at the pressures desired.

The special Adjustment Tool 66-214 (sold separately) is also available to set desirable pressure setting while attached to the pressure source.

- Re-tighten pressure port with 12 ft. lb. max.
- Reconnect electrical circuit with 12 ft. lb. max.

WARNING DECLARATION

If this switch is used to protect equipment or personnel from unsafe pressure or to guard against the hazardous release of contained substances it must be installed and operated in accordance with applicable codes, regulations and standards. This switch must be used in conjunction with system design(s) or procedure(s) necessary to mitigate any hazard resulting from its failure. Conform to installation instructions accompanying this switch. Individuals who ignore this warning may suffer serious or fatal injury and do so at their own risk. Custom Control Sensors is not liable for any misuse, abuse, suitability or adequacy of user's application of the switch. Service by qualified personnel only.

Custom Control Sensors, Inc

21111 Plummer Street
Chatsworth, CA 91311
Tel: (818) 341-4610 • Fax: (818) 709-0426
<http://www.ccsdualsnap.com>